



CONTINUED FROM  
18840822426

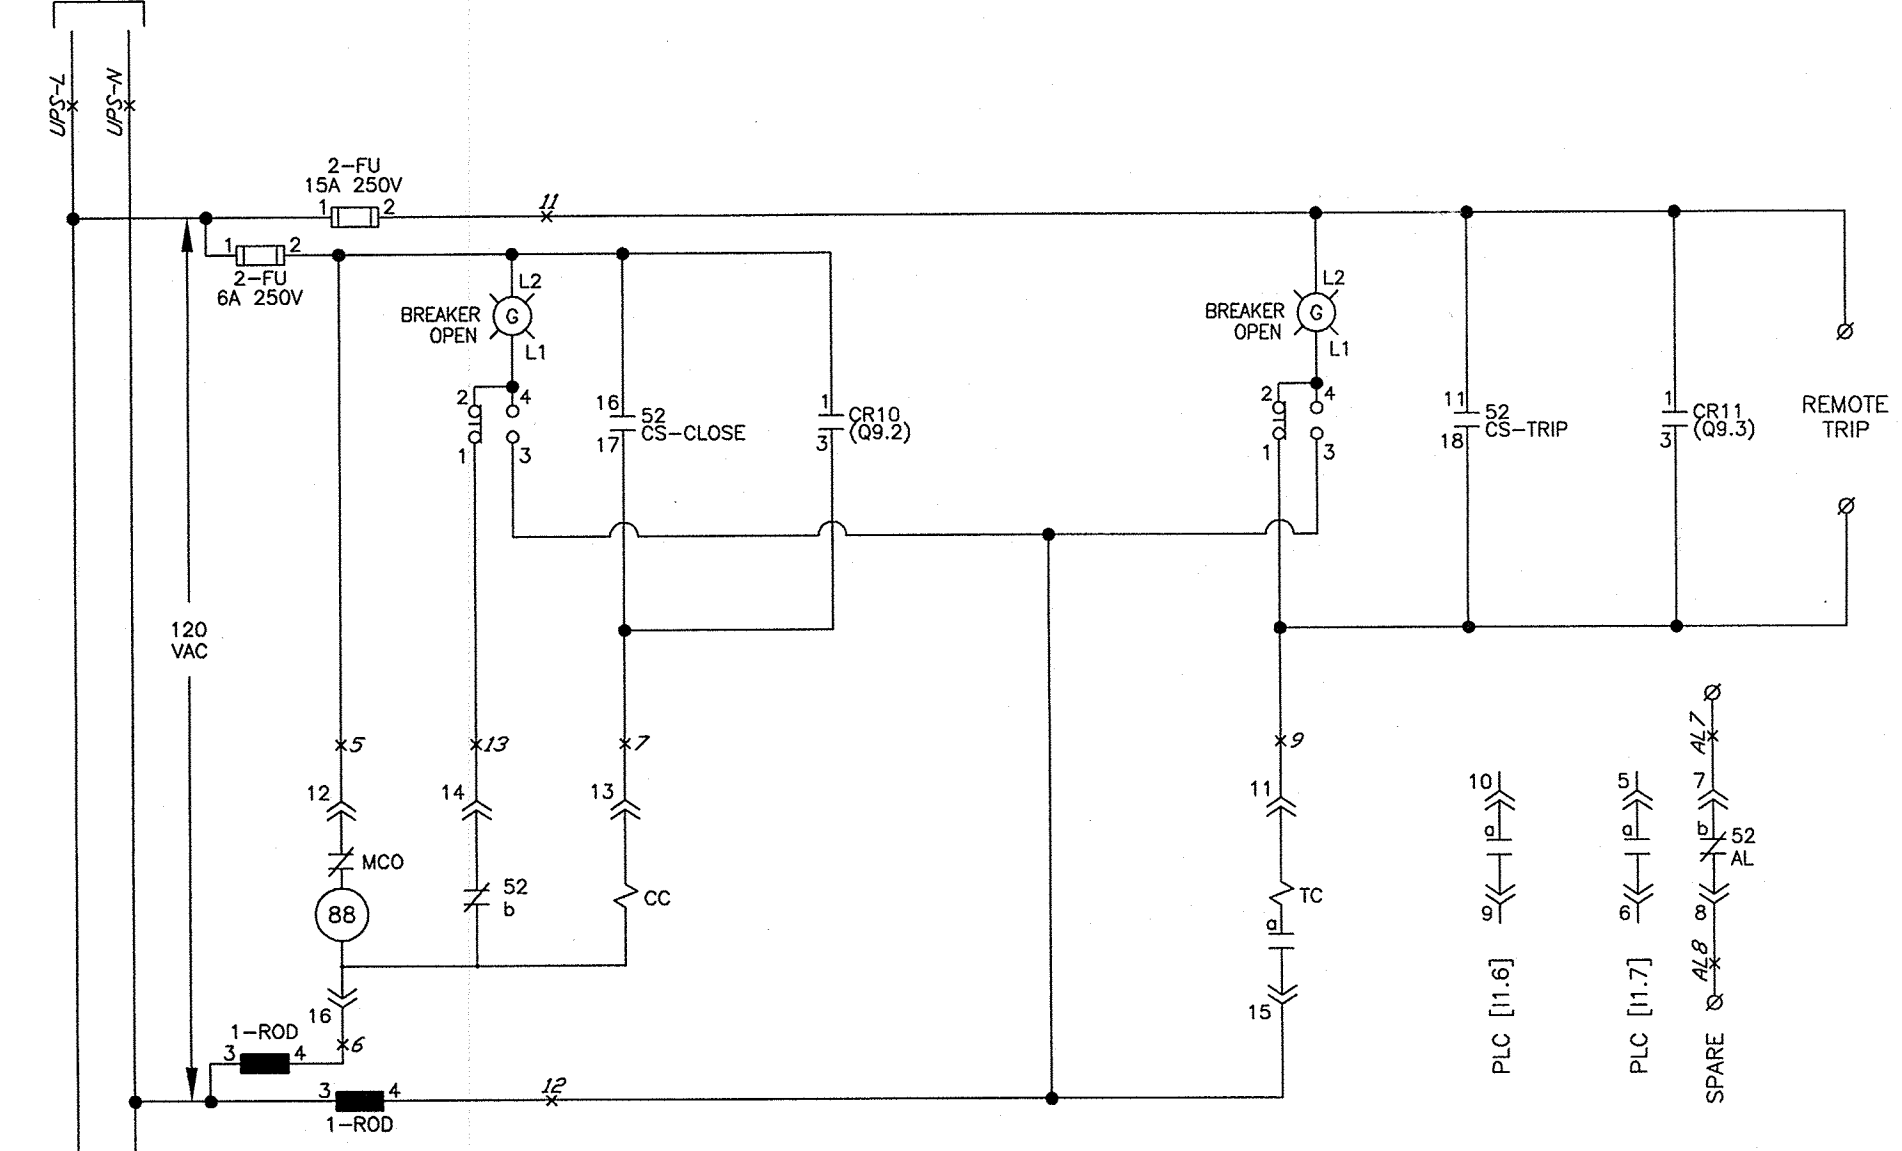

ELECTRICALLY-OPERATED FEEDER BREAKER CONTROL CIRCUIT COMPT 3D

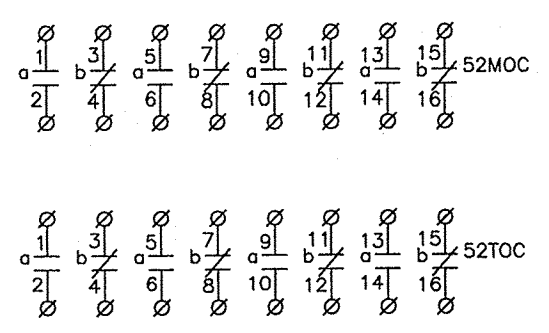

DECK	CONTACTS HANDLE END	POSITIONS		
		1	2	3
1	11	X		
	16		X	

CONTROL SWITCH  
SPRING RETURN TO NORMAL  
ELECTRO SWITCH CAT. NO.  
2438D


WARNING: TO ENSURE AGAINST ELECTRIC SHOCK OR ACCIDENT DANGER, DISCONNECT ALL SOURCES OF SUPPLY BEFORE SERVICING.

PROD. TYPE R	Siemens Energy & Automation, Inc. Raleigh, NC
SCALE NTS	DWG NAME BREAKER 3D & 4B CONTROL CIRCUITS
DR: AP:	DR: AP:
DOC. NO. 18840822427	PAGE: 1 NEXT: F


PRE: X  
APP: 210955  
CER: A6X30014124

CUSTOMER: AMGEN RI  
LOCATION: GREENWICH, RHODE ISLAND  
PROJECT: 480V WWTTP SUBSTATION  
CUSTOMER PO: C247404

01 02/02/07

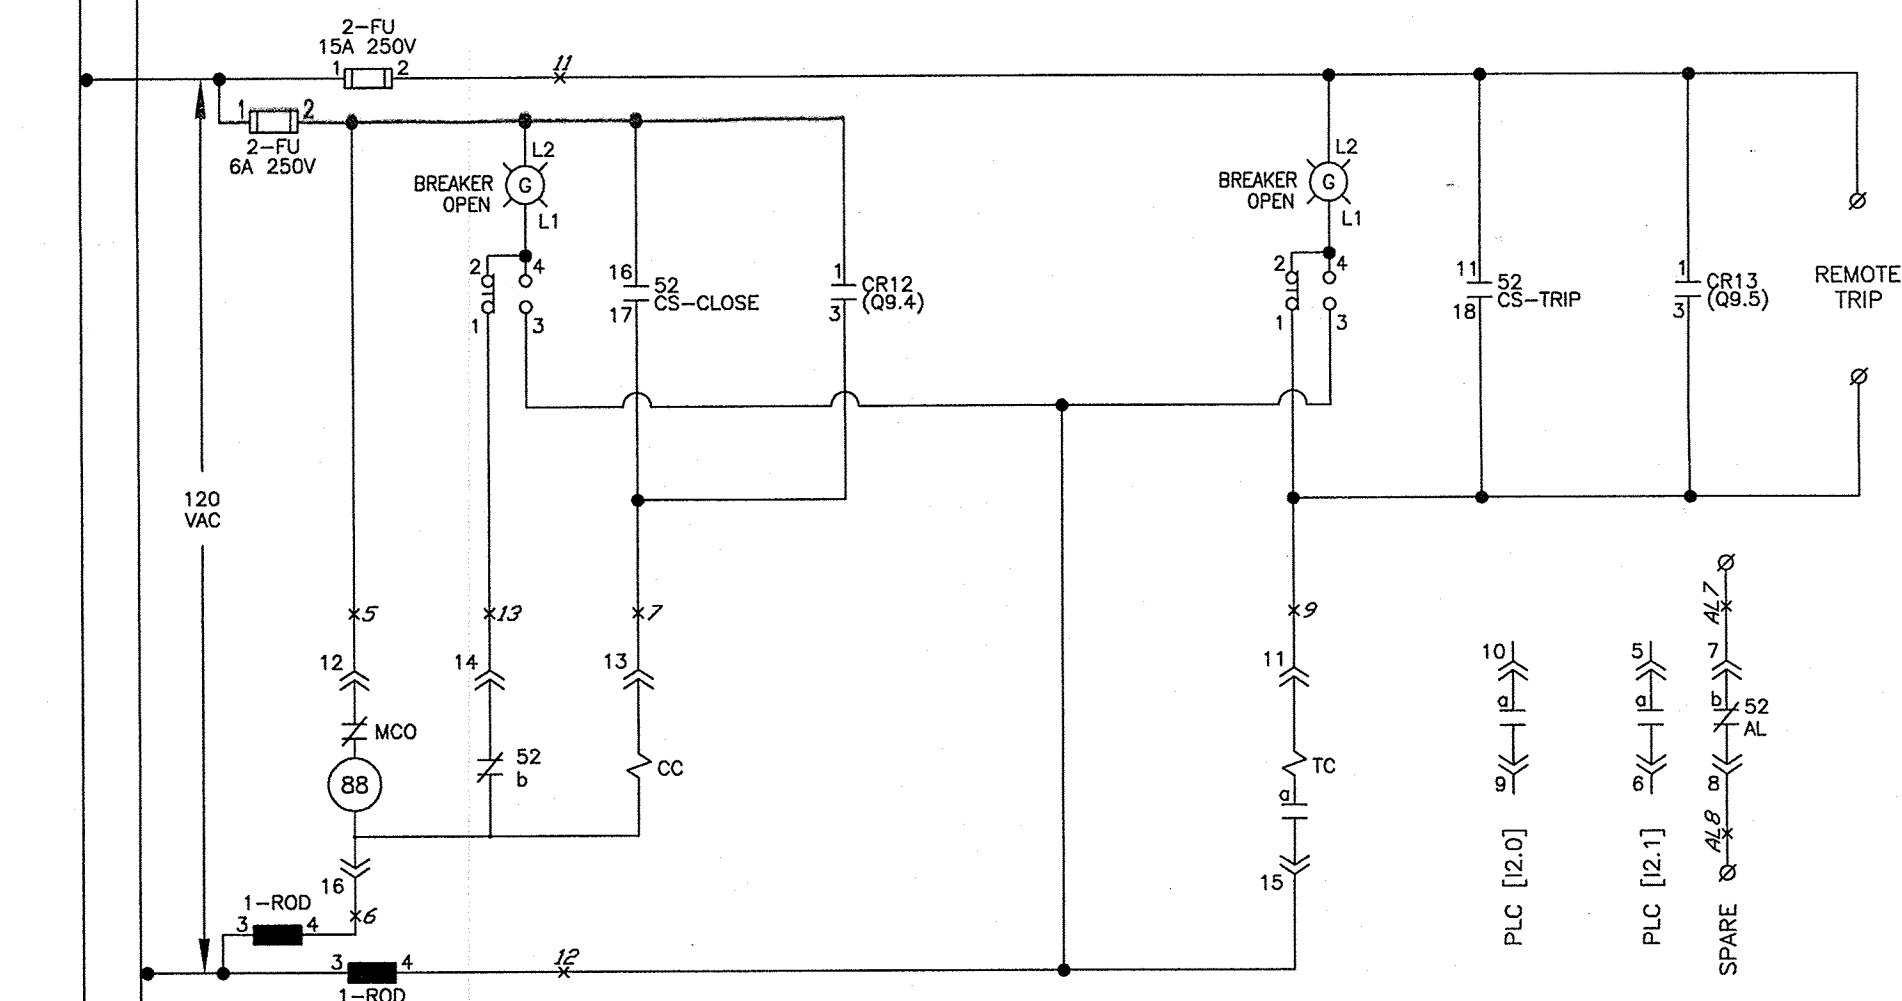

ELECTRICALLY-OPERATED FEEDER BREAKER CONTROL CIRCUIT COMPT 4B

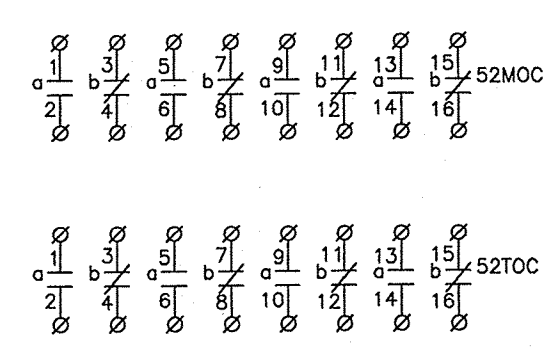

DECK	CONTACTS HANDLE END	POSITIONS		
		1	2	3
1	11	X		
	16		X	

CONTROL SWITCH  
SPRING RETURN TO NORMAL  
ELECTRO SWITCH CAT. NO.  
2438D

USE NON-PVC TUBE-TYPE LABELS AS WIRE MARKERS ON BOTH ENDS OF ALL WIRES.  
BREAKERS, RELAYS AND AUXILIARY SWITCHES ARE SHOWN IN DE-ENERGIZED POSITION.  
CUSTOMER'S CONNECTIONS ARE SHOWN DASHED.  
THE STANDARD SECONDARY WIRE IS #14 SIS UNLESS OTHERWISE STATED.

CONTINUED TO  
18840822428